


68 Mill End Rd, Cambridge, CB1 9JP  
Annexe  
WK/201254577



Mike Bailey  
29-11-12  
NTS

## Key To Symbols

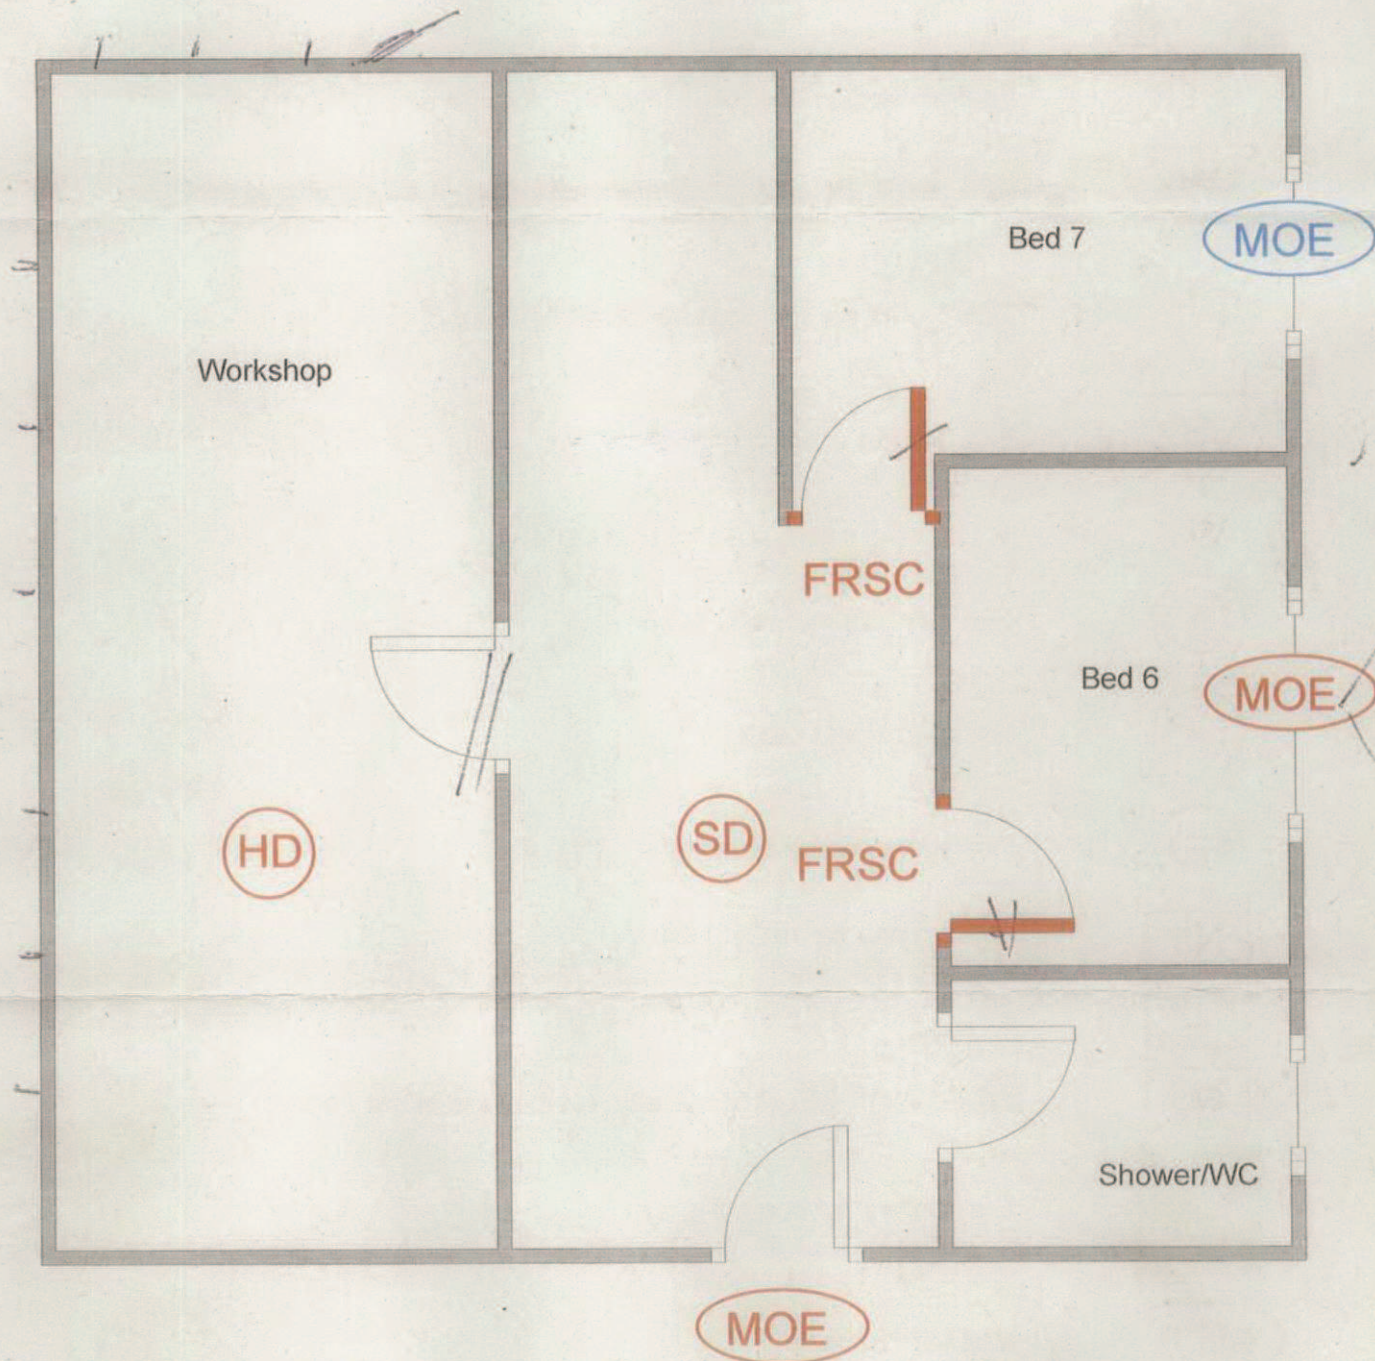


½ Hour fire resistant construction



½ Hour fire resistant door with combined intumescent strip & smoke seal

SC

Self-closing device (Gib-closer or Gibraltar type not permitted)



13A Rated fire extinguisher on wall mount (traditionally water type)



34B Rated fire extinguisher on wall mount (traditionally dry powder type)



Fire blanket – wall mounted

VP

½ Hour fire rated glazed vision panel



Fire alarm manual call-point



Fire alarm heat detector



Fire alarm smoke detector



Fire action / fire routine sign (adj call-points)




FIRE DOOR KEEP LOCKED SHUT sign (outer face of fire door)



FIRE DOOR KEEP SHUT sign (both sides of fire door)



Emergency lighting coverage



Means of escape



Existing fire precautions in blue