


Appendix A: Compliance Dashboard

<div>Domestic Gas Safety Compliance (Including Communal) Properties with a valid Landlord Gas Safety Certificate</div> <div><div>0 Expired</div><div>6610 Properties</div></div> <div><div>100%</div></div>		Current Compliance	100%
		Trend Since Last Report 99.98%	↑
<div>Asbestos Re-Inspections</div> <div><div>342 Overdue</div><div>773 Communal</div></div> <div><div>56%</div></div>		Current Compliance	56%
		Trend Since Last Report 20%	↑
<div>Properties with a satisfactory Electrical Inspection Condition Report (EICR)</div> <div><div>1955 Expired</div><div>7852 Properties</div></div> <div><div>75%</div></div>		Current Percentage Compliance	75%
		Trend Since Last Report 61.53%	↑
<div>Lift Inspection Compliance</div> <div><div>1 Overdue</div><div>48 Inspections</div></div> <div><div>98%</div></div>		Current Percentage Compliance	98%
		Trend Since Last Report 98%	↔

Appendix A: Compliance Dashboard

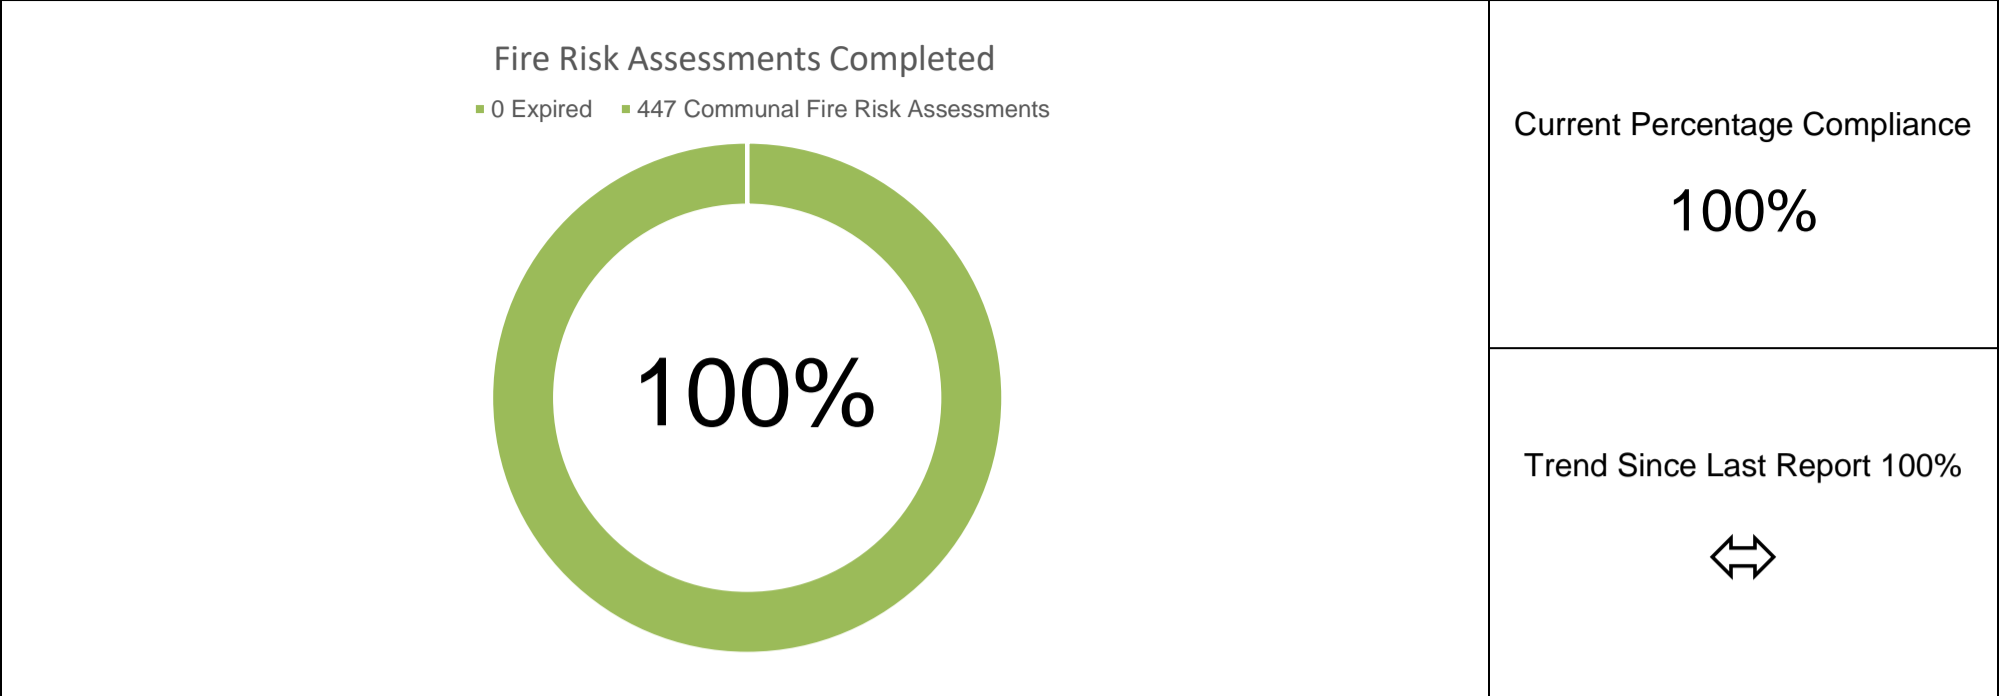


Fire Actions

	Complete	Not Overdue	Overdue	Total
High	331		260	591
Medium	291		949	1240
Low	301	52	692	1045
Grand Total	923	52	1901	2876


Low: Unusually low likelihood of fire as a result of negligible potential sources of ignition.

Medium: Normal fire hazards (e.g. potential ignition sources) for this type of occupancy, with fire hazards generally subject to appropriate controls (other than minor shortcomings).

High: Lack of adequate controls applied to one or more significant fire hazards, such as to result in significant increase in likelihood of fire

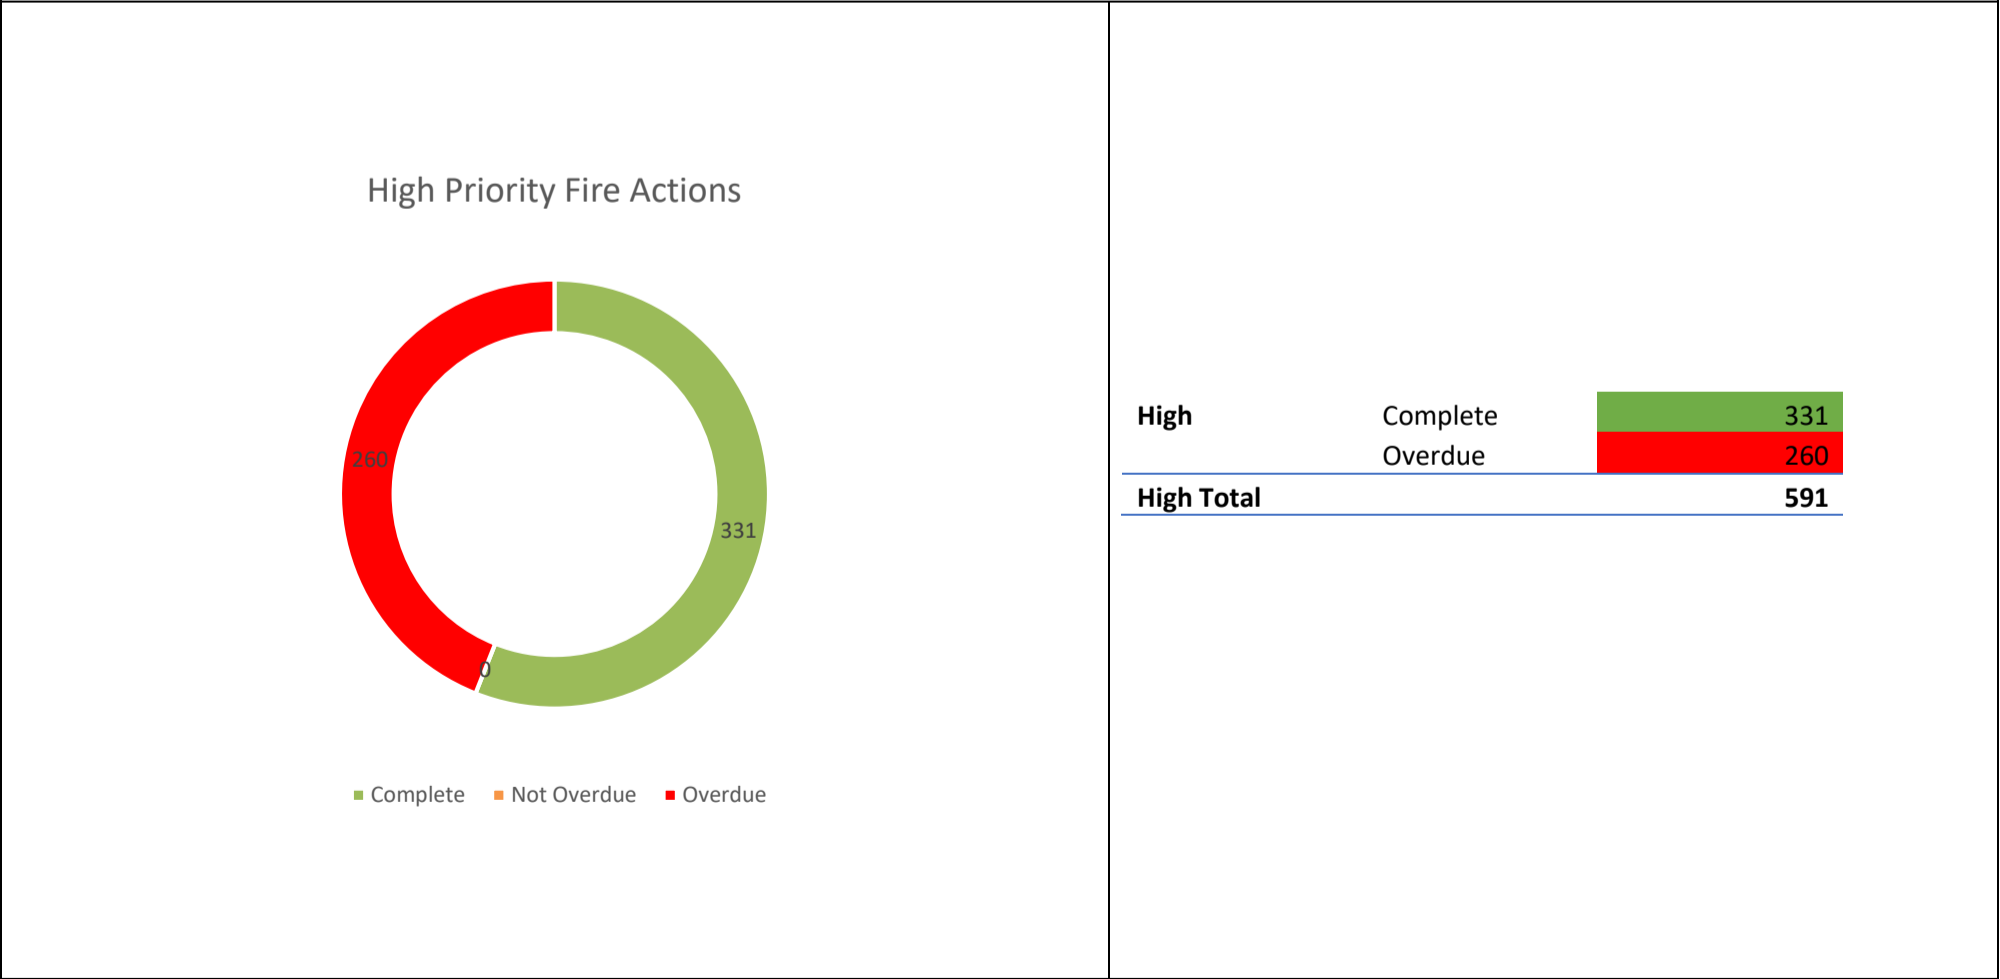

Appendix A: Compliance Dashboard

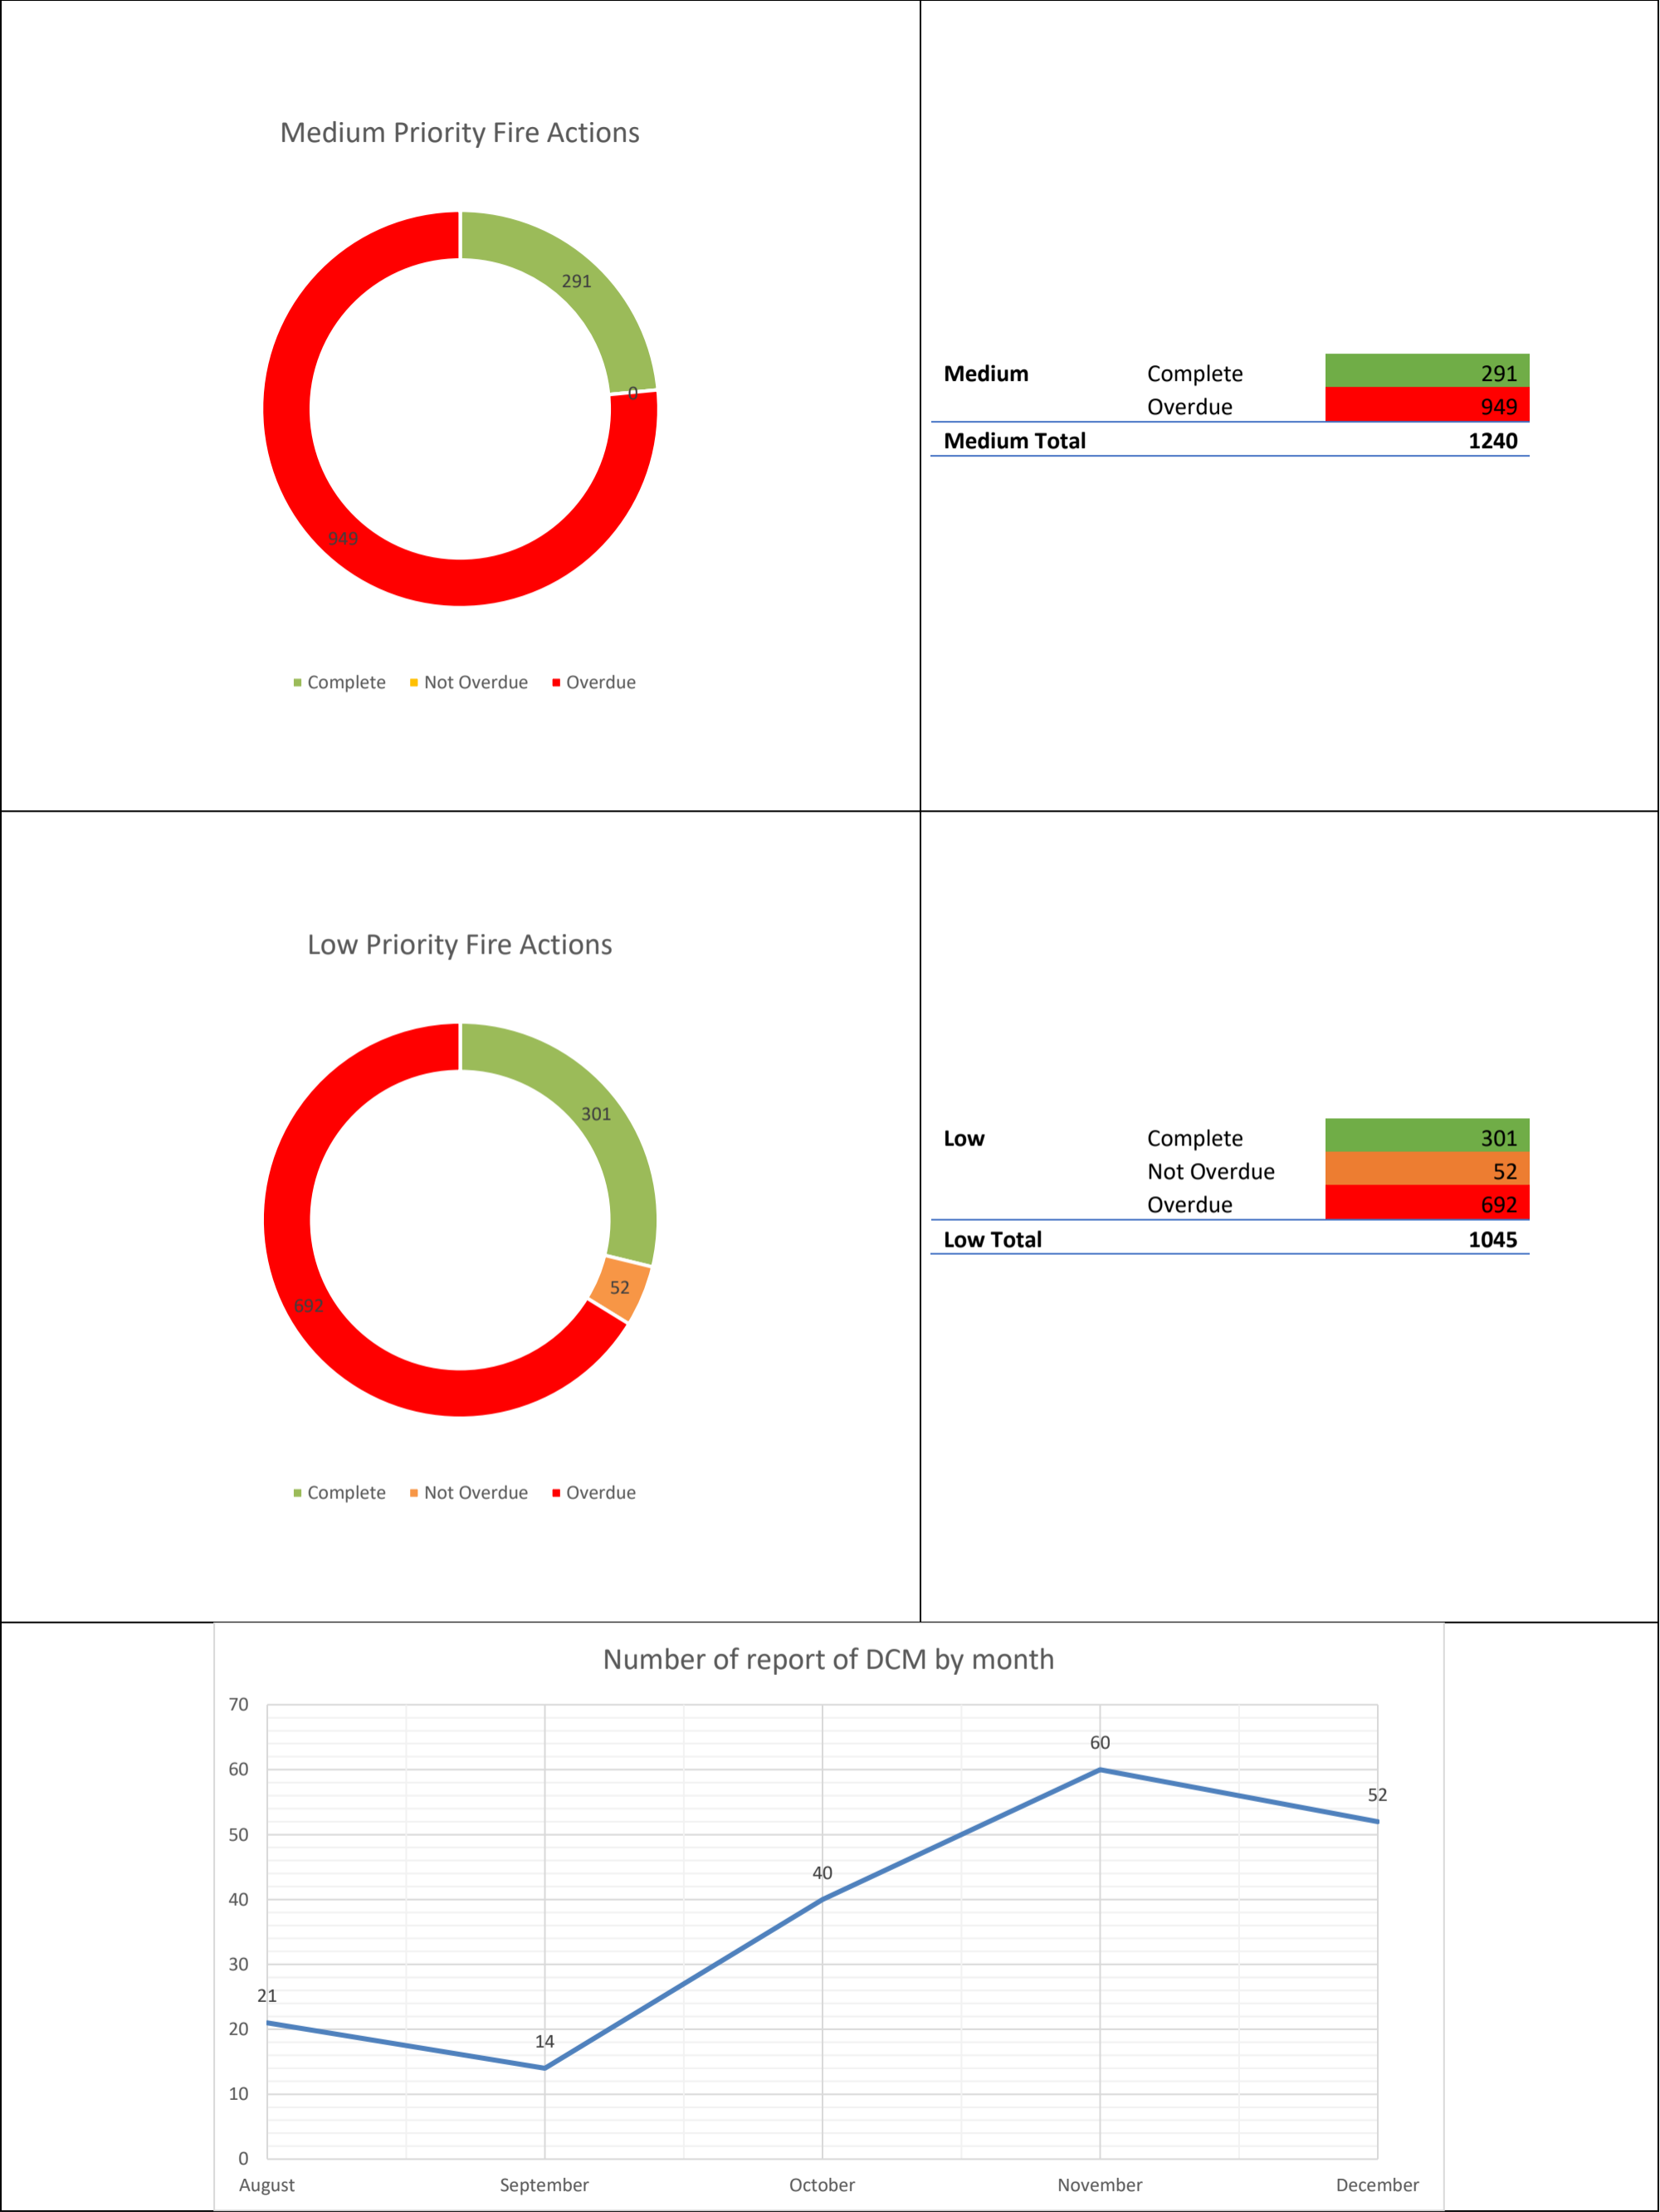

Appendix A: Compliance Dashboard

